

# Connected Relay Switch 10A

Zigbee Interface and Behaviour

04/2022

# Legal Information

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this guide are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owners.

This guide and its content are protected under applicable copyright laws and furnished for informational use only. No part of this guide may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the guide or its content, except for a non-exclusive and personal license to consult it on an “as is” basis. Schneider Electric products and equipment should be installed, operated, serviced, and maintained only by qualified personnel.

As standards, specifications, and designs change from time to time, information contained in this guide may be subject to change without notice.

To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this material or consequences arising out of or resulting from the use of the information contained herein.

# Connected Relay Switch 10A

- Device Integration
  - Commissioning Journey
    - Commissioning with Install Code
    - Commissioning without Install Code
  - Factory Reset
  - LED Behavior
    - Different LED color meanings in the default settings
    - LED behavior when output is ON and OFF for different user settings
- Common rules
  - Meaning of colors
  - Table sizes for router devices
  - Common rules for some clusters for Router devices
- Device depended values of some attributes
- Endpoint 0
- Endpoint 1
  - Server clusters
    - Basic cluster server, cluster id 0x0000
    - Identify cluster server, cluster id 0x0003
    - Groups cluster server, cluster id 0x0004
    - Scenes cluster server, cluster id 0x0005
    - OnOff cluster server, cluster id 0x0006
    - Diagnostic cluster server, cluster id 0x0B05
  - Client clusters
    - Otau cluster client, cluster id 0x0019 (always only on the first non-zero endpoint on device)
- Endpoint 21
  - Server clusters
    - Basic cluster server, cluster id 0x0000
    - Identify cluster server, cluster id 0x0003
    - Schneider switch configuration cluster server, cluster id 0xFF17
    - Diagnostic cluster server, cluster id 0x0B05
  - Client clusters
    - Identify cluster client, cluster id 0x0003
    - Group cluster client, cluster id 0x0004
    - OnOff cluster client, cluster id 0x0006
    - Level control cluster client, cluster id 0x0008
    - Scene cluster client, cluster id 0x0005
    - Window covering cluster client, cluster id 0x0102
- Endpoint 242
  - Server clusters
  - Client clusters
    - Outbound cluster client, cluster id 0x0021

# Device Integration

This document covers the information for system integration for the corresponding device which includes:

- Commissioning Journey with and without Install Code
- Factory Reset
- LED behavior
- Guidelines for System Integration
- Zigbee Specification
  - Endpoints
  - Clusters
  - Attributes
  - Commands

The Connected Device covered in this document is certified with Zigbee 3.0.

## Commissioning Journey

There are 2 ways of commissioning:

1. Commissioning by using the Install Code (QR code)
2. Commissioning without using the Install Code

### Commissioning with Install Code

Commissioning using the Install Code is the most secure way in Zigbee networks. During the commissioning process, it uses the unique install code that is lasered on the product in text format and as a QR code. Therefore, there is no possibility to use a network sniffer to get the network encryption key when install code commissioning is used.

The Install Code can be found on the product itself in 2 formats:

- Text format containing the Zigbee MAC address of the product in the EUI-64 line and the random generated Install Code afterwards.
- QR code format containing the Zigbee MAC address and the Install Code in a special format for smart phone applications to read easily.  
The QR code format is: **<ZBE MAC ADDRESS>|<INSTALL CODE>**

To start the commissioning with install code, the user must either scan the QR code from the App or enter the Zigbee MAC address and the Install Code manually in the App. Afterwards, the user should short press 3x on the pushbutton (upper right pushbutton in case there are multiple buttons).

When the commissioning starts, the product will scan all the Zigbee channels and find a network to join that has the correct MAC address and Install Code.

The commissioning window is 30 seconds and during this time, the device LED blinks in orange color.

### Commissioning without Install Code

It is highly recommended that the system supports Install Code Commissioning as it is the most secure way. However, the devices also support commissioning without the install code.

In this case, the user has to open the network to add a new device (most probably from the App) and short press 3x on the pushbutton (upper right pushbutton in case there are multiple buttons).

The device will scan the channels to find an open network to join using the standard ZigbeeAlliance09 (for centralized network) and the standard Zigbee Distributed Network (for distributed network) key.

The commissioning window is 30 seconds and during this time, the device LED blinks in orange color.

## Factory Reset

The factory reset process for the devices follows a standard approach.

To perform the factory reset manually on the product, the user has to short press the pushbutton 3x and then on the 4th press, hold the button for 10 seconds.

If the pattern is done correctly, after 10 seconds the LED will start blinking in red color.

At this point, the user can release the pushbutton. The device will perform the factory reset and restart.

After the restart, the LED will be in Orange color indicating that it is not a part of any Zigbee network.

Refer to the supplied installation manual for details.

## LED Behavior

The device have a bi-color LED with green and red color. When both LED's are on, the color is orange.

### Different LED color meanings in the default settings

LED	Meaning
-----	---------

Solid Orange	Device is not part of any Zigbee network.
Blinking Orange	Device is trying to join a Zigbee network, timeout 30 seconds. (Starts after 3x short press when device is not commissioned) .
Solid Red	After device is commissioned to a Zigbee network, Solid Red means output is ON.
LED OFF	After device is commissioned to a Zigbee network, LED Off means the output is OFF.
Solid Green: (In default settings)	It means the Zigbee network is open to add new devices.
Short Green Blinking	Simplified Room Control mode is active. Actuator is trying to pair with a Wireless Switch.
Blinking Red @1Hz	Only possible after factory reset pattern is done (3x short press and hold for 10 seconds).

### LED behavior when output is ON and OFF for different user settings

LED behavior	Explanation
Consistent with Load	LED is red when load is ON, LED is Off when load is OFF
Reverse with Load	LED is Off when load is ON, LED is green when load is OFF.
Always ON	LED is red when load is ON, LED is green when load is OFF.
Always OFF	LED is Off regardless of the state of the output (ON or OFF).

The LED setting can be found on endpoint 21 and/or Endpoint 22, Schneider manufacture specific Switch Configuration Cluster (0xFF17), Attribute SwitchIndication (0x0000).

## Common rules

### Meaning of colors

Color	Meaning
	Schneider manufacture specific.
	Value depends on device type, see device description.
	Used as note and explanation.

### Table sizes for router devices

Table	Count of entries
Routing table	16
Child table	10
Broadcast table	15
Neighbor table	26
Binding table	100
Scene table	80
Reporting table	20

### Common rules for some clusters for Router devices

Cluster name	Cluster id	Cluster type	Note
BASIC	0x0000	SERVER	Shared across all endpoints except endpoint 242
DIAGNOSTIC	0x0B05	SERVER	Shared across all endpoints except endpoint 242
OTAU	0x0019	CLIENT	Present only on first (non zero) endpoint in device
OUTBOUND	0x0021	CLIENT	Present only on endpoint 242

## Device depended values of some attributes

Attribute name	Cluster	Endpoint	Value
Model Identifier (0x0005)	Basic (0x0000)	all	NHPB/SWITCH/1
Product Model (0xE009)	Basic (0x0000)	all	NHPB/SWITCH/1
Product Identifier (0xE007)	Basic (0x0000)	all	17420
Image Type ID (0x0008)	OTAU (0x0019)	first non zero	0x0010
Switch Actions (0x0001)	Schneider switch configuration (0xFF17)	21	0

## Endpoint 0

Endpoint	Profile	Device ID	Description	Application
0	0x0000: Zigbee device profile			ZigBee Device Object (ZDO) – standard management features.



# Endpoint 1

Endpoint	Profile	Device ID	Description	Application
1	0x0104: Common profile (HA)	0x0100	On/Off light	This endpoint provides control of the output via on/off clusters. It supports groups and scenes, as well as reporting for on/off state. The identify cluster allows for push-button commissioning as a target.

 This endpoint corresponds always to the first output channel.

## Server clusters

### Basic cluster server, cluster id 0x0000

Basic cluster is shared across all endpoints (except of endpoint 242).

#### Common attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x0000	ZCL version	uint8	0	255	1/0	3	1		0xFFFF	
Setting ZCLVersion to 3 means this product complies with ZCL V7.										
0x0007	Power source	enum8	0	255	1/0	1	1		0xFFFF	
0 = Unknown, 1 = Mains (single phase), 2 = Mains (3 phase), 3 = Battery, 4 = DC source, 5 = Emergency mains constantly powered, 6 = Emergency mains and transfer switch.										
0x0001	Application version	uint8	0	255	1/0	See note	1		0xFFFF	
Major version of attribute 0xE001.										
0x0002	Stack version	uint8	0	255	1/0	6	1		0xFFFF	
Default value regarding communication stack.										
0x0003	HW version	uint8	0	255	1/0	See note	1		0xFFFF	
Major version of 0xE002 attribute.										
0x0004	Manufacture name	string			1/0	Schneider Electric	1		0xFFFF	
The ManufacturerName attribute is 'Schneider Electric'.										
0x0005	Model identifier	string			1/0	See note	1		0xFFFF	
Value is formatted as 'A/B/C' where: A (gang): 1GANG, 2GANG, PUCK, NHRROTARY, NHMOTION, NHPB, FLS B (type of device): SWITCH, DIMMER, 1-10V, ESWITCH, SHUTTER, DALI, CU, AIRLINK, SYSTEM-M C (count of channels): 1, 2, 4 Look on device description to find default value for your device.										
0x4000	SW build id	string			1/0	See note	1		0xFFFF	
Identical value as in attribute 0xE001.										
0x0006	DateCode	string			1/0	See note	1		0xFFFF	
The DateCode attribute is a ZigBee character string with a maximum length of 16 bytes. The first 8 characters specify the date of manufacturer of the device in international date notation according to ISO 8601, i.e., YYYYMMDD, e.g., 20060814. Could be empty for some series, otherwise following format will be used: YYYYMMDD.										
0x000A	ProductCode	octetstring			1/0		1		0xFFFF	
The ProductCode attribute allows an application to specify a code for the product. Empty string for this device.										
0x000B	ProductUrl	string			1/0	<a href="http://www.schneider-electric.com">http://www.schneider-electric.com</a>	1		0xFFFF	
Shall have identical value as 0xE00B.										
0xE001	Application FWVersion	string			1/0	See note	1		0xFFFF	
The Application FW Version attribute specifies the firmware version of the application. The format of this attribute is XXX.YYY.ZZZ V. XXX = major version YYY = minor version ZZZ = patch version V = Build Type (One of the following: D = Development version, T0, T1 = Verification version, V = Validation version, R = Official Release version).										

0xE002	Application HWVersion	string			1/0	See note	1		0xFFFF	
<p>The Application HWVersion attribute specifies the hardware version of the application design in format AAA.BBB.CCC. Meaning:  AAA - major version  BBB - minor version  CCC - patch version</p> <p>If version is 000.000.000, HW version is not available.</p>										
0xE004	SerialNumber	string			1/0	See note	1		0xFFFF	
Device serial number. Hexadecimal string of 15 chars length.										
0xE007	ProductIdentifier	enum16			1/0	See note	1		0xFFFF	
The ProductIdentifier attribute specifies the unique internal numerical identifier of the product. See device description for this value.										
0xE008	ProductRange	string			1/0	Wiser Light	1		0xFFFF	
The ProductRange attribute specifies the name of the range to which the product belongs.										
0xE009	ProductModel	string			1/0	See note	1		0xFFFF	
The ProductModel attribute specifies the name of the product model. Same value as model identifier attribute 0x0005.										
0xE00A	ProductFamily	string			1/0	Wiser Home	1		0xFFFF	
The ProductFamily attribute specifies the name of the family to which the product belongs.										
0xE00B	VendorURL	string			1/0	<a href="http://www.schneider-electric.com">http://www.schneider-electric.com</a>	1		0xFFFF	
0xFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

### Attributes for lighting devices

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x0008	GenericDeviceClass	enum8	0	255	1/0	0	1		0xFFFF	
The GenericDeviceClass attribute define the field of application of the GenericDeviceType attribute. Value 0 used for lighting.										
0x0009	GenericDeviceType	enum8	0	255	1/0	0xE1	1		0xFFFF	
The GenericDeviceType for light control devices is 0xE1 (Wall switch).										

### Commands received

Command id	Name	Length [bytes]	Bytes
0x00	Reset to factory default	0	
On receipt of this command, the device resets all the attributes of all its clusters to their factory defaults. Local bindings are not created. If device supports some default scenes, scenes are recreated.			

## Identify cluster server, cluster id 0x0003

### Usage

Identify action depends on used endpoint. E.g. endpoint 6, 21, 22 blinks with front LED, endpoints 1, 2, 3, 4 flash with lights, endpoint 5 is going little bit down/up with shutter. Time step is defined as 1.5 seconds.

### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x0000	IdentifyTime	uint16	0	0xFFFF	1/1	0	0		0xFFFF	
If this attribute is set to a value other than 0x0000 then the device SHALL enter its identification procedure, in order to indicate to an observer which of several devices it is. The IdentifyTime attribute SHALL be decremented every second. To start identification you can either write some non zero value in this attribute or send command identify. Value 0 stops identification.										
0xFFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	1	1		0xFFFF	

### Commands received

ID	Name	Length [bytes]	Bytes	Meaning	Notes
0x00	Identify	2	0	identify time LSB	LSB of timeout, how long device shall stay in identification in seconds.
			1	identify time MSB	MSB of timeout, how long device shall stay in identification in seconds.
The identify command starts or stops the receiving device identifying itself. Value 0 in field 'identify time' stops identification, otherwise device stays in identification for time defined in field 'identify time'.					
0x01	Identify query	0			
This command has no payload and allows the sending device to request the target or targets to respond if they are currently identifying themselves.					

## Groups cluster server, cluster id 0x0004

### Attributes

ID	Name	Type	Min	Max	Read/Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x0000	Name support	map8	0	0x80	1/0	0	1		0xFFFF	
0 = names are not supported, 0x80 = names supported.										
0xFFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

### Commands received

ID	Name	Length [bytes]	Bytes	Meaning	Notes
0	Add group	2+x	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
			x	group name	Not supported, use value 0 as string terminator.
On receipt of this command, the device SHALL (if possible) add the Group ID and Group Name to its Group Table. The Group Name field is ignored.					
1	View group	2	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
The view group command allows the sending device to request that the receiving entity or entities respond with a view group response command containing the application name string for a particular group.					
2	Get group membership	1+x	0	group count	Count of groups in field 'group list'.
			x	group list	List of 16-bits integers.
Responds with group membership information using the get group membership response.					
3	Remove group	2	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
Removes this endpoint from the specified group. Also removes all scenes that refer to this group. Device SHALL then generate an appropriate Remove Group Response command indicating success or failure.					
4	Remove all groups	0			
Removes this endpoint from all groups. Also removes all scenes that refer to any of the existing groups.					
5	Add group if identifying	2+x	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
			x	group name	Not supported, use value 0 as string terminator.
Adds this endpoint to the group, if the endpoint is identifying. The Group Name field is ignored.					

## Scenes cluster server, cluster id 0x0005

### Attributes

Id	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x0000	SceneCount	uint8	0	10	1/0	See note	1		0xFFFF	
Holds the total number of scenes (across all groups) currently stored on the device. For C4B 2 Gang devices with shutter, 1 channel relay switch, 1 channel electronic switch, DALI dimmer, 1-10V dimmer and 1 channel dimmer inserts default value is 2. For all other devices default value is 0.										
0x0001	CurrentScene	uint8	0	255	1/0	0	0	5	3600	1
If the SceneValid attribute is true, this attribute, together with the CurrentGroup attribute, indicates the currently active scene.										
0x0002	CurrentGroup	uint16	0	0xFFF7	1/0	0	0	5	3600	1
If the SceneValid attribute is true, this attribute, together with the CurrentScene attribute, indicates the currently active scene.										
0x0003	SceneValid	bool	0	1	1/0	0	0	5	3600	1
If true, the scene identified by CurrentGroup and CurrentScene is currently active, i.e. all device attribute values match the values in the scene field set.										
0x0004	NameSupport	map8	0	0x80	1/0	0	1		0xFFFF	
0 = names are not supported, 0x80 = names supported. Device does not support names.										
0xFFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

### Commands received

Id	Name	Length [bytes]	Bytes	Meaning	Notes
0	Add scene	5+x	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
			2	scene id	Scene ID 0x00-0xFF.
			3	LSB transition time	LSB of the time in seconds, it will take for the device to change from its current state to the requested scene. Not supported.
			4	MSB transition time	MSB of the time in seconds, it will take for the device to change from its current state to the requested scene. Not supported.
			5	string len	Length of scene name. If name is not present, value here shall be 0xFF. Our device does not support scene name.
			x	scene definition	Scene name followed by Extension field set. For more explanation please take a look in ZCL specification scene extension field set for cluster you define the scene.
Adds a scene with or without a scene field set. Detailed description in ZCL specification. The format of each extension field set is a 16 bit field carrying the cluster ID, followed by an 8 bit length field and the set of scene extension fields specified in the relevant cluster. The length field holds the length in octets of that extension field set. Extension field sets = {{clusterId 1, length 1, {extension field set 1}}, {clusterId 2, length 2, {extension field set 2}} ...}.					
1	View scene	3	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
			2	scene id	Scene ID 0x00-0xFF.
On receipt of this command, except for the restrictions in 3.7.2.4.1 ZCL specification, the device SHALL generate an appropriate View Scene Response command.					
2	Remove scene	3	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
			2	scene id	Scene ID 0x00-0xFF.
Removes a scene from the scene table. If the command was addressed to a single device (not a group) then it SHALL generate an appropriate Remove Scene Response command indicating success or failure.					
3	Remove all scenes	2	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.

Removes all scenes that belong to a particular group. If the command was addressed to a single device (not to a group) it SHALL then generate an appropriate Remove All Scenes Response command indicating success or failure.					
4	Store scene	3	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
			2	scene id	Scene ID 0x00-0xFF.
Stores the device's current state as a scene or updates a previously stored scene accordingly. If the command was addressed to a single device (not to a group) then it SHALL generate an appropriate Store Scene Response command indicating success or failure.					
5	Recall scene	5	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
			2	scene id	Scene ID 0x00-0xFF.
			3	LSB transmission time	May or not be present. LSB transmission time in 1/10 seconds.
			4	MSB transition time	May or not be present. MSB transmission time in 1/10 seconds.
Recall the scene stored in device under group and scene ID.					
6	Get scene membership	2	0	LSB group ID	LSB of group Id 0x0000-0xFFFF7.
			1	MSB group ID	MSB of group Id 0x0000-0xFFFF7.
Returns the set of scenes (within the scope of the specified group) currently stored on the device. On receipt of this command, the device SHALL if addressed to a single device generate an appropriate Get Scene Membership Response command.					

## OnOff cluster server, cluster id 0x0006

### Common attributes


Id	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x0000	OnOff	bool	0	1	1/0	0	0	5	600	1
Indicates the current state of the output relay, either on = 'true' or off = 'false'.										
0x4002	OffWaitTime	uint16	0	0xFFFF	1/1	0	0		0xFFFF	
The OffWaitTime attribute specifies the length of time (in 1/10ths second) that the 'off' state SHALL be guarded to prevent an on command turning the device back to its 'on' state (e.g., when leaving a room, the lights are turned off but an occupancy sensor detects the leaving person and attempts to turn the lights back on). If this attribute is set to 0x0000, the device SHALL remain in its current state. This attribute is used only with conjunction with 'On with timed off' command.										
0xE001	OnTimeReload	uint32	0	0xFFFFFFFF	1/1	0	1		0xFFFF	
Defines number of seconds before the light is switched off automatically. Time is in seconds. Value 0 disable the functionality. When brightness is changed, or ON command is received, timer is always restarted. Check OnTimeReloadOptions for possible impulse mode (if attribute is implemented).										
0xFFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

### Attributes (lighting devices)

Id	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x4001	OnTime	uint16	0	0xFFFF	1/1	0	0		0xFFFF	
Time, in tenths of a second, the device remains on, before it automatically turns off. This value is set by the 'On with timed off' command. This is a 'live' down counter. Value 0x0000 or 0xFFFF means, that device is not automatically switched off. This attribute is not set if device state is ON and device has OnTimeReload attribute set to non zero value (will be switched OFF automatically).										
0xE000	PreWarningTime	uint16	0	6553	1/1	0	1		0xFFFF	
Has meaning only if attribute OnTimeReload is not 0. Defines number of seconds before the light is switched off automatically when the user is somehow inform the light will be switched off automatically. Value 0 or 0xFFFF disables prewarning. For switch is is just short switch OFF and ON, for dimmer device goes to 60 percent and starts slowly dimm down. During this time user can reload the time and postpone automatic switch off for time defined in OnTimeReload. If you enter value greater that 6553, after reboot you will read again value 6553. If you enter 0xFFFF, functionality will be disabled. See Prewarning behavior picture below.										
0xE002	OnTimeReloadOptions	map8	0	1	1/1	1	1		0xFFFF	
bit0: 1 = OnTimeReload timer can be canceled by receiving OFF command -> light is going OFF immediately, 0 = can not be canceled, is always restarted. bit1 added later, check release notes for your FW version. bit1 : 1 = Impulse mode active. Whenever output should be switched ON, will be switched ON only for 200msec. OnTimeReload attributes is ignored, also bit0 inside this attribute has no sense. 0=impulse mode is disabled. bit2-bit7: reserved.										

### Prewarning behavior

A:Switch, B:Dimmer, C:Timer value, D:pre-warning time (30sec)

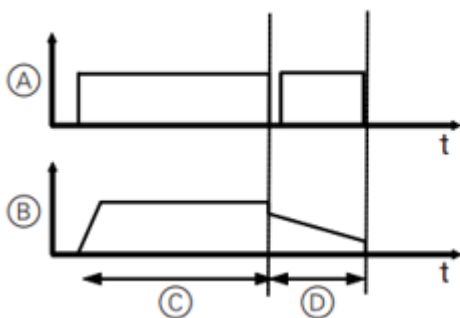


### Commands received

Id	Name	Length [bytes]	Bytes	Meaning	Notes
0	Off	0			
Turns the output off. The attached load will be disconnected from the mains					
1	On	0			
Turns the output on. The attached load will be connected to the mains.					

2	Toggle	0			
Turns the output off, it was turned on or turns the output on, if it was turned off.					
0x42	On with timed off	5	0	on/off control	bit0 - 1 = accept only when ON
			1	LSB on time	LSB stay ON for this time in 1/10 sec. Range 0-0xffff
			2	MSB on time	MSB stay ON for this time in 1/10 sec. Range 0-0xffff
			3	LSB off wait time	LSB after switched OFF, ignore ON command for this time in 1/10 sec. Range 0-0xffff.
			4	MSB off wait time	MSB after switched OFF, ignore ON command for this time in 1/10 sec. Range 0-0xffff.
Turns the output on and then automatically turns it off after the specified time has elapsed. For implementation check the below picture.					

On with timed off command

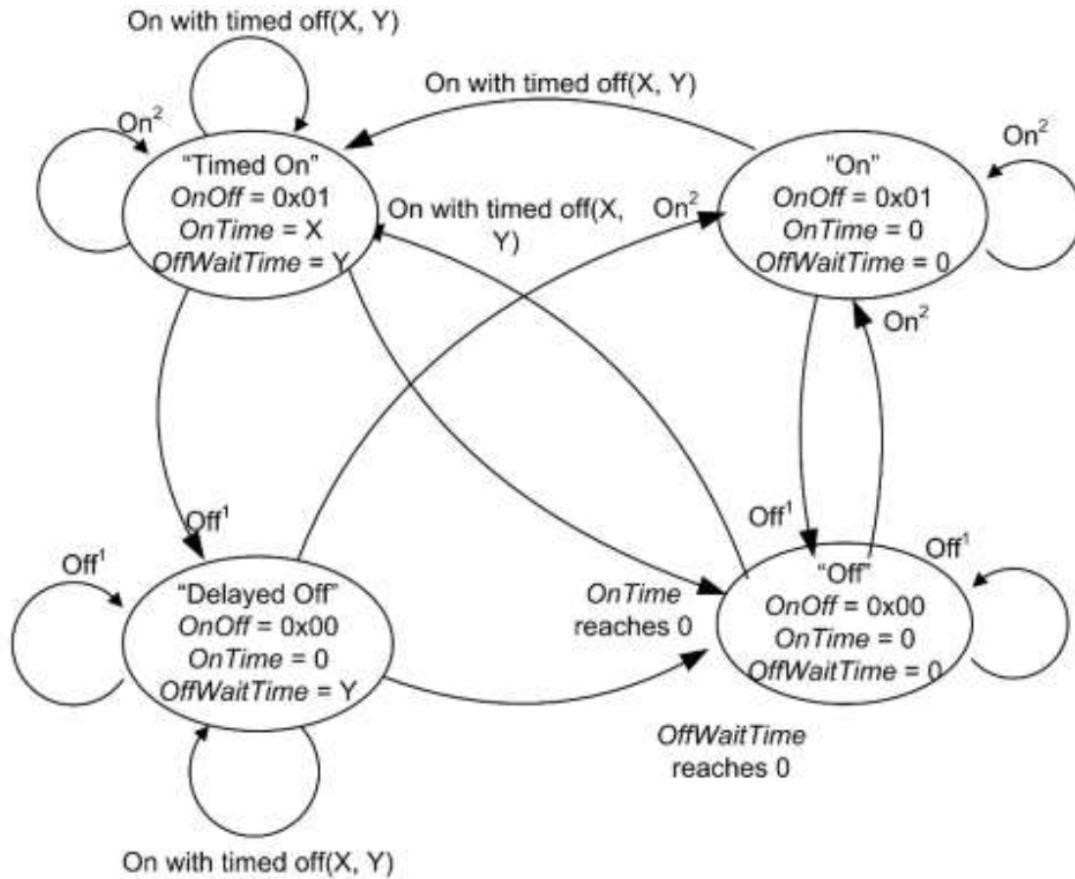

Note 1: Any command which causes the *OnOff* attribute to be set to 0x00, e.g. Off, Toggle or Off with i  
Note 2: Any command which causes the *OnOff* attribute to be set to 0x01, e.g. On, Toogle or On with i  
global scene.



## Diagnostic cluster server, cluster id 0x0B05

Diagnostic cluster is shared across all endpoints (except of endpoint 242).

### Attributes common

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x011C	Last Message LQI	uint8	0	0xFF	1/0	See note	0	900	900	255
<p>Default value depends on currentLQI.</p> <p>This is the Link Quality Indicator for the last message received. There is no current agreed upon standard for calculating the LQI. For some implementations LQI is related directly to RSSI for others it is a function of the number of errors received over a fixed number of bytes in a given message. The one thing that has been agreed is that the Link Quality Indicator is a value between 0 and 255 where 0 indicates the worst possible link and 255 indicates the best possible link. Note that for a device reading the Last Message LQI the returned value SHALL be the LQI for the read attribute message used to read the attribute itself.</p>										
0x011D	Last Message RSSI	int8	-127	127	1/0	See note	0	900	900	127
<p>Default value depends on currentRSSI.</p> <p>This is the receive signal strength indication for the last message received. As with Last Message LQI, a device reading the Last Message RSSI, the returned value SHALL be the RSSI of the read attribute message used to read the attribute itself.</p>										
0xFFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

## Client clusters

### Otau cluster client, cluster id 0x0019 (always only on the first non-zero endpoint on device)

#### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting			Notes
								Min [s]	Max [s]	Change [-]	
0x0000	UpgradeServerId	eui64	0	0xFFFFFFFFFFFF	1/0	0xFFFFFFFFFFFF	0		0xFFFF		
IEEE address of upgrade server.											
0x0001	FileOffset	uint32	0	0xFFFFFFFF	1/0	0xFFFFFFFF	0		0xFFFF		
The parameter indicates the current location in the OTA upgrade image. It is essentially the (start of the) address of the image data that is being transferred from the OTA server to the client. The attribute is optional on the client and is made available in a case where the server wants to track the upgrade process of a particular client.											
0x0002	CurrentFileVersion	uint32	0	0xFFFFFFFF	1/0	See note	0		0xFFFF		
The file version of the running firmware image on the device. Correlation between Application FW Version attribute 0xE001 in basic cluster and this attribute is visible on following example:  '003.002.001 D' = 0x03020100 '003.002.001 T0' = 0x03020102 '003.002.001 T1' = 0x03020103 '003.002.001 V' = 0x03020104 '003.002.001 R' = 0x030201FF											
0x0006	ImageUpgradeStatus	enum8	0	0xFF	1/0	0x00	0		0xFFFF		
The upgrade status of the client device.  0 = Normal 1 = Download in progress 2 = Download complete 3 = Waiting to upgrade 4 = Count down 5 = Wait for more  <b>Note for devices running version prior 2.0.0. If output of device is ON, or shutter is running, value in this attribute is set to 4 so long, till device is switched OFF permanently for 10 seconds or shutter remains 10 seconds on the same position.</b>											
0x0007	Manufacturer ID	uint16	0	0xFFFF	1/0	0x105E	1		0xFFFF		
Schneider manufacture ID.											
0x0008	Image Type ID	uint16	0	0xFFFF	1/0	0xFFFF	1		0xFFFF		
This attribute SHALL indicate the image type identifier of the file that the client is currently downloading, or a file that has been completely downloaded but not upgraded to yet. The value of this attribute SHALL be 0xFFFF when the client is not downloading a file or is not waiting to apply an upgrade.  Each ZB device inside SE has unique id. Please look into device description.											
0xFFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	3	1		0xFFFF		

#### Commands received

- It is out of scope of this document. All mandatory commands are supported.

#### Command generated

- After reboot in 5 minutes (randomly) device asks for new image.
- Every **6 hours mains powered** devices ask for new image, **battery** powered devices ask **every 96 hours**.
- If OTA server asks device for waiting before applying downloaded image, device asks every 10 minutes for applying image.
- Discovering of OTA server for **mains powered** devices is done every **1 minute**, if not discovered before, **battery** powered devices discover **every 48 hours**.

#### Responses received

- It is out of scope of this document. All mandatory responses are supported.

## Endpoint 21

Endpoint	Profile	Device ID	Description	Application
21	0x0104: Common profile (HA)	0x0104	Dimmer switch	This endpoint is used to transmit on/off, level, open/close and scene control commands triggered by pushbuttons. Used for 1-gang or for right buttons in case of 2-gang devices. For FLS look into FLS device description.



To be able to control first channel on device locally must be bound to local actuator's endpoint (first one) on the same device (is done automatically when device joins network). However you are free to disconnect it or connect to some other device via ZigBee.

## Server clusters

### Basic cluster server, cluster id 0x0000

Cluster is shared. More details you find on first (non-zero) endpoint.

## Identify cluster server, cluster id 0x0003

### Usage

Identify action depends on used endpoint. E.g. endpoint 6, 21, 22 blinks with front LED, endpoints 1, 2, 3, 4 flash with lights, endpoint 5 is going little bit down/up with shutter. Time step is defined as 1.5 seconds.

### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x0000	IdentifyTime	uint16	0	0xFFFF	1/1	0	0		0xFFFF	
If this attribute is set to a value other than 0x0000 then the device SHALL enter its identification procedure, in order to indicate to an observer which of several devices it is. The IdentifyTime attribute SHALL be decremented every second. To start identification you can either write some non zero value in this attribute or send command identify. Value 0 stops identification.										
0xFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	1	1		0xFFFF	

### Commands received

ID	Name	Length [bytes]	Bytes	Meaning	Notes
0x00	Identify	2	0	identify time LSB	LSB of timeout, how long device shall stay in identification in seconds.
			1	identify time MSB	MSB of timeout, how long device shall stay in identification in seconds.
The identify command starts or stops the receiving device identifying itself. Value 0 in field 'identify time' stops identification, otherwise device stays in identification for time defined in field 'identify time'.					
0x01	Identify query	0			
This command has no payload and allows the sending device to request the target or targets to respond if they are currently identifying themselves.					

## Schneider switch configuration cluster server, cluster id 0xFF17

This is a manufacture specific cluster. Is used for configuration, what command and from what client cluster is sent when user presses the button on HMI interface.

### Attributes

Id	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x0000	SwitchIndication	enum8	0	3	1/1	0	1		0xFFFF	
<p><b>Attribute is shared between all endpoints where this cluster is presented.</b></p> <p>Attribute defines the meaning of indicator (LED) on the device, which provides the feedback to user about state of output.            0 = indicator is on when load is on            1 = Indicator is always on            2 = indicator is on when load is off            3 = Indicator is always off.</p>										
0x0010	UpSceneID	uint8	0	0xFF	1/1	0x00	1		0xFFFF	
<p>The UpSceneID attribute represents the Scene Id field value of any Scene command cluster transmitted by the device when user activates is rocker up side according to the rocker configuration. See SwitchActions attribute.</p>										
0x0011	UpGroupID	uint16	0	0xFFFF	1/1	0x0000	1		0xFFFF	
<p>The UpGroupID attribute represents the Group Id field value of any Scene command cluster transmitted by the device when user activates is rocker up side according to the rocker configuration. Value greater than 0xFFF7 means, no command is sent. See SwitchActions attribute.</p>										
0x0020	DownSceneID	uint8	0	0xFF	1/1	0x01	1		0xFFFF	
<p>The DownSceneID attribute represents the Scene Id field value of any Scene command cluster transmitted by the device when user activates is rocker down side according to the rocker configuration. See SwitchActions attribute.</p>										
0x0021	DownGroupID	uint16	0	0xFFFF	1/1	0x0000	1		0xFFFF	
<p>The DownGroupID attribute represents the Group Id field value of any Scene command cluster transmitted by the device when user activates is rocker down side according to the rocker configuration. Value greater than 0xFFF7 means, no command is sent. See SwitchActions attribute.</p>										
0x0001	SwitchActions	enum8	0	0xFF	1/1	See note	1		0xFFFF	
<p>Default values depends on endpoint and device type. More info you find in device description.            See SwitchActions attribute picture. If value is one of non defined, switch does not send any action when pressed.</p>										
0xFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	1	1		0xFFFF	

## Definition of SwitchActions attribute for rocker switch

Switch actions used as enumeration for SwitchActions manufacture specific attribute in Switch Configuration manufacture specific cluster (rocker switch HMI)				
Function name [value]	first press	short release UP/DOWN BUTTON	long press UP/DOWN BUTTON	long release UP/DOWN BUTTON
Light [0x00]	x	ON / OFF	ON / OFF	x
Light opposite [0xFE]	x	OFF / ON	OFF / ON	x
Dimmer [0x01]	x	ON / OFF	UP(WITH ON_OFF) / DOWN	STOP / STOP
Dimmer opposite [0xFD]	x	OFF / ON	DOWN/UP(WITH ON_OFF)	STOP / STOP
Standard Shutter [0x02]	x	STOP / STOP	OPEN / CLOSE	x
Standard Shutter opposite [0xFC]	x	STOP / STOP	CLOSE / OPEN	x
Schneider Shutter [0x03]	x	STOP_STEP_UP / STOP_STEP_DOWN *	OPEN / CLOSE	x
Schneider Shutter opposite [0xFB]	x	STOP_STEP_DOWN / STOP_STEP_UP *	CLOSE / OPEN	x
Scene** [0x04]	x	RECALL_SCENE_X / RECALL_SCENE_Y	SAVE_SCENE_X / SAVE_SCENE_Y	x
Toggle light [0x05]	x	x	x	x
Toggle dimmer [0x06]	x	x	x	x
Alternate light [0x07]	x	x	x	x
Alternate dimmer [0x08]	x	x	x	x
Not Used [0x7F]	x	x	x	x

## Definition of SwitchActions attribute for rotary

Switch actions used as enumeration for SwitchActions manufacture specific attribute in Switch Configuration manufacture specific cluster (rotary HMI)						
Function name [value]	first press	short release	long press	long release	step RIGH /LEFT	rotate RIGHT/LEFT
Light [0x00]	x	TOGGLE	OFF	x	ON / OFF	ON
Light opposite [0xFE]	x	TOGGLE	ON	x	OFF / ON	OFF
Dimmer [0x01]	x	TOGGLE	OFF	x	STEP_UP (WITH ON_OFF) / STEP_DOWN (with fixed step size)	STEP_UP (WITH ON_OFF) / STEP_DOWN (step size depends on rotation speed)
Dimmer opposite [0xFD]	x	TOGGLE	OFF	x	STEP_DOWN / STEP_UP (WITH ON_OFF) (with fixed step size)	STEP_DOWN / STEP_UP (WITH ON_OFF) (step size depends on rotation speed)
Standard Shutter [0x02]	x	STOP	x	x	STOP / STOP	OPEN / CLOSE
Standard Shutter opposite [0xFC]	x	STOP	x	x	STOP / STOP	CLOSE / OPEN
Schneider Shutter [0x03]	x	STOP	x	x	STOP_STEP_UP / STOP_STEP_DOWN *	OPEN / CLOSE

Schneider Shutter opposite [0xFB]	x	STOP	x	x	STOP_STEP_ DOWN / STOP_STEP_ UP *	CLOSE / OPEN
Scene** [0x04]	x	x	x	x	x	x
Toggle light [0x05]	x	x	x	x	x	x
Toggle dimmer [0x06]	x	x	x	x	x	x
Alternate light [0x07]	x	x	x	x	x	x
Alternate dimmer [0x08]	x	x	x	x	x	x
Not Used [0x7F]	x	x	x	x	x	x

C o l o r	Meaning
	Command will be sent from Level control cluster
	Command will be sent from ON/OFF cluster
	Command will be sent from Scene Cluster
	Command will be sent from Window covering cluster
*	This is a Schneider manufacture specific command from Window Covering Cluster
**	Scene number is taken from attribute Up/DownSceneID and group from Up/DownGroupID. Command is sent via binding table. If Up /DownGroupID attribute is set to 0xFFFF, no command is sent. If pushbutton HMI is used, UpSceneId and UpGroupId is used.
x	No reaction

## **Diagnostic cluster server, cluster id 0x0B05**

Cluster is shared. More details you find on first (non-zero) endpoint.



## Client clusters

### Identify cluster client, cluster id 0x0003

#### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0xFFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	1	1		0xFFFF	

#### Commands received

- None.

#### Command generated

- Identify Query Command

#### Responses received

- Identify Query Response command

### Group cluster client, cluster id 0x0004

#### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0xFFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

#### Commands received

- None.

#### Command generated

- None.

#### Responses received

- None.

### OnOff cluster client, cluster id 0x0006

#### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0xFFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

#### Commands received

- None.

#### Commands generated

In principal following commands are supported:

- On.
- Off.
- Toggle.

Which command is used depends on device type.

- For motion devices look on *OccupancyActions* attribute in Schneider manufacture specific cluster *occupancy setting*.
- For all other devices look on *SwitchActions* attribute in Schneider manufacture specific cluster *Schneider switch configuration*.

In some FW versions commands are sent only as unicast using binding table. Please check the release notes.

### Responses received

- None.

## Level control cluster client, cluster id 0x0008

### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0xFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

### Commands received

- None.

### Commands generated

In principal following commands are supported:

- Move with on off (only direction UP).
- Move without on off (only direction DOWN).
- Step with on off (only direction UP, with fixed step size).
- Step without on off (only direction DOWN, with fixed step size).
- Stop.
- Move to level with on off (only motion devices).

Which command is used depends on device type.

- For motion devices look on *OccupancyActions* attribute in Schneider manufacture specific cluster *occupancy setting*.
- For all other devices look on *SwitchActions* attribute in Schneider manufacture specific cluster *Schneider switch configuration*.

In some FW versions commands are sent only as unicast using binding table. Please check the release notes.

### Responses received

- None.

## Scene cluster client, cluster id 0x0005

### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0xFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

### Commands received

- None.

### Commands generated

In principal following commands are supported:

- Store scene.
- Recall scene.

If and how commands are used depends on *SwitchActions* attribute in Schneider manufacture specific cluster *Schneider switch configuration*.

**In some FW versions commands are sent only as unicast using binding table. Please check the release notes.**

### Responses received

- Out of scope of this document.

## Window covering cluster client, cluster id 0x0102

### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0xFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	2	1		0xFFFF	

### Commands received

- None.

### Commands generated

In principal following commands are supported:

- Open.
- Close.
- Stop.
- StopOrStepLiftPercentage (manufacture specific - see section 'received commands' in *window covering cluster*). This command is send with field '*step value*' to 25 = 25% of *TiltOpenCloseAndStepTime* attribute.

If and how commands are used depends on *SwitchActions* attribute in Schneider manufacture specific cluster *Schneider switch configuration*

**In some FW versions commands are sent only as unicast using binding table. Please check the release notes.**

### Responses received

- Out of scope of this document.

# Endpoint 242

Endpoint	Profile	Device ID	Description	Application
242	0xA1E0: Green Power Profile	0x0061	GreenPowerProxyBasic	ZigBee Green Power Combined Proxy and Sink.

## Server clusters

None

## Client clusters

### Outbound cluster client, cluster id 0x0021

#### Attributes

ID	Name	Type	Min	Max	Read /Write	Default	Persistent	Reporting		
								Min [s]	Max [s]	Change [-]
0x0010	GppMaxProxyTableEntries	uint8	0	0	1/0	5	0		0xFFFF	
Maximum number of Proxy Table entries supported by this device. (In Specs default value is 0x14)										
0x0011	ProxyTable	longoctetstring			1/0		1		0xFFFF	
Proxy Table, holding information about pairings between a particular GPD ID and the sinks in the network. (In Specs default value is 0x00)										
0x0016	GppFunctionality	bitmap24	0	0xFFFFFFFF	1/0	0x09AC2F	0		0xFFFF	
The optional GP functionality supported by this proxy. See Zigbee Cluster Library for more information.										
0x0017	GppActiveFunctionality	bitmap24	0	0xFFFFFFFF	1/0	0xFFFFFFFF	0		0xFFFF	
The optional GP functionality supported by this proxy that is active. See Zigbee Cluster Library for more information.										
0x0022	GpLinkKey	securityKey	0	0xFFFFFFFFFFFFFFFFFFFFFFFF	1/1	0x5a6967426565416c6c69616e63653039	1		0xFFFF	
The security key to be used to encrypt the key exchanged with the GPD. See Zigbee Cluster Library for more information.										
0xFFFD	ClusterRevision	uint16	1	0xFFFE	1/0	1	1		0xFFFF	

#### Commands received

- It is out of scope of this document. All mandatory commands are supported.

#### Command generated

- It is out of scope of this document. All mandatory commands are supported.

#### Responses received

- It is out of scope of this document. All mandatory responses are supported.